

**CHORE-TIME®**

# 9715 THERMOSTAT

for Chore-Time Thermostat Controlled Fans


installation - wiring

The 9715 Thermostat is available for use with Chore-Time® thermostat controlled fans.

Mount the thermostat vertically in a location where it will sense "average" temperature of the room. Avoid installations where the thermostat will be subjected to hot or cold drafts, direct sunlight, sources of radiated, convected or conducted heat, or locations near cold surfaces.

If practical, mount at or near eye level so the thermostat can be read and set easily. Install on a wall or partition using wood screws installed through the mounting holes in the back of the case.

Wire the thermostat according to the wiring diagram in this instruction. All wiring should be done by a qualified electrician and must be in accordance with Local and National Electrical Codes. Ground all electrical equipment!

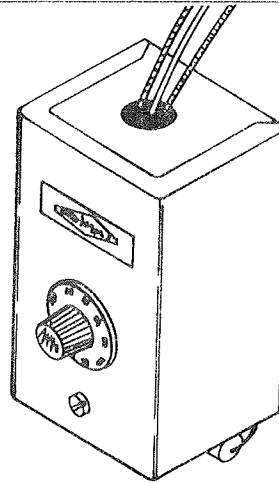


## ELECTRICAL RATINGS

	120VAC	240 VAC	277VAC
FULL LOAD	16.0 A	12.0 A	10.0 A
LOCKED ROTOR	80.0 A	60.0 A	50.0 A
NON-INDUCTIVE	25.0 A	25.0 A	22.0 A
PILOT DUTY	125 VA	125 VA	125 VA

## NOTES FOR WIRING DIAGRAM

1. All electrical wiring must be done by a qualified electrician in accordance with Local and National Electrical Codes.
2. Disconnect electrical power before installing or servicing equipment.
3. Ground all electrical equipment.
4. Use wire nuts on all unused conductors to prevent electrical shock or damage.

## Wiring Connection Diagram

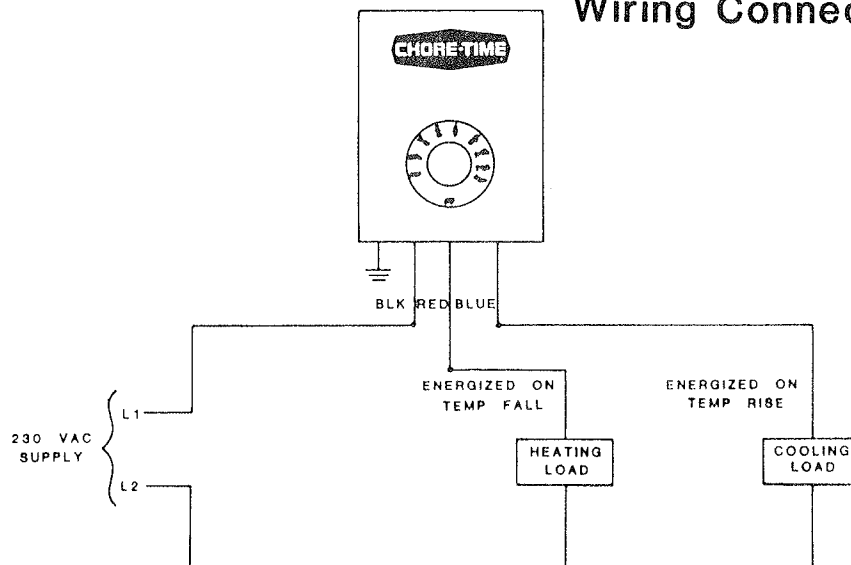

WARNING: INSULATE ANY UNUSED LEAD WIRES

Printed in U.S.A.

Contact your nearby CHORE-TIME® distributor or representative for additional information or parts.  
Chore-Time Equipment, Inc.; Milford, Indiana 46542; Decatur, Alabama 35601; Modesto, California 95356; Maldegem, Belgium.

485A-1084